# **Your Inspection Report**

# 626 Adelaide St W Toronto, ON M6J 1A9





PREPARED FOR: ROGER TRAVASSOS

**INSPECTION DATE:** Monday, June 10, 2024

PREPARED BY: Milo Petrovic, B. Eng., RHI

Carson, Dunlop & Associates Ltd. 120 Carlton Street, Suite 407 Toronto, ON M5A 4K2

# 416-964-9415

www.carsondunlop.com inspection@carsondunlop.com

Excellence in home inspection



June 10, 2024

Dear Roger Travassos,

RE: Report No. 88685 626 Adelaide St W Toronto, ON M6J 1A9

Thank you for choosing us to perform your home inspection. We hope the experience met your expectations.

The enclosed report includes an Overview tab which summarizes key findings, and the report body. The Good Advice tab provides helpful tips for looking after your home; the Reference tab includes a 500-page Reference Library; and the Appendix tab includes valuable added benefits. You can navigate by clicking the tabs at the top of each page.

TO THE PROSPECTIVE BUYER: We strongly recommend an Onsite Review of the home to help you understand the inspection report and protect your investment. The Review includes a tour of the home with the inspector, a complimentary safety recall service on appliances and ensures that you can take advantage of the special offers listed in the appendix most of them are free. You also receive free technical support for as long as you own your home. The Onsite Review fee is \$260.

Thanks again for choosing Carson Dunlop

Sincerely,

Milo Petrovic, B. Eng., RHI on behalf of Carson, Dunlop & Associates Ltd.

> Carson, Dunlop & Associates Ltd. 120 Carlton Street, Suite 407 Toronto, ON M5A 4K2 416-964-9415 www.carsondunlop.com inspection@carsondunlop.com

OVER	/IEW							Report	No. 88685	
626 Adelai	626 Adelaide St W, Toronto, ON June 10, 2024 www.carsondunlop.com									
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR	

# OUR ADVICE APPENDIX REFERENCE

This Overview lists some of the significant report items if any were identified. Please read the entire report before making any decisions about the home; do not rely solely on the Overview.

# FOR THE BUYER

There are two elements to a home inspection - the inspection itself and the report. This report is helpful, but the inspection is equally important. You need both elements to make an informed decision. Call us at 416-964-9415 to book a Buyers Review with the inspector. Our fee is \$260. Without a Buyers Review, our obligation and liability are limited to the seller.

When you move into the home you may find some issues not identified in the report. That is to be expected for a few reasons, such as furniture and storage that has been removed, changes to the property conditions, etc. Therefore, we suggest you allow roughly 1% of the value of the home annually for maintenance and repair.

# Plumbing

# WATER HEATER \ Life expectancy

**Condition:** • Near end of life expectancy

- New tank (similar type and size) can be purchased for \$1,200 to \$2,400. Rental tank can be obtained for minimal/no cost and carried for a monthly fee. Seller reports current unit is a rental; contact rental provider for more information when necessary.

Task: Replace

Time: When necessary

Here are a few thoughts to help you stay warm, safe and dry in your home.

All homes require regular maintenance and periodic updates. Maintenance programs help keep homes safe, comfortable and efficient. Roofs, furnaces and air conditioners for example, wear out and have to be replaced. Good maintenance extends the life of these house systems. Refer to Our Advice tab for more details regarding maintenance of your home.

Water is the biggest enemy of homes, whether from leaks through the roof, walls or foundation, or from plumbing inside the home. Preventative maintenance and quick response to water problems are important to minimize damage, costs and help prevent mould.

Environmental consultants can help with issues like mould, indoor air quality and asbestos. If you need help in these areas, we can connect you with professionals.

All recommendations in the report should be addressed by qualified specialists. Our ballpark costs and time frames are provided as a courtesy and should be confirmed with quotes from specialists. Minor costs in the report are typically under \$1,000.

END OF OVERVIEW

ROOFI	ROOFING Report No. 88685										
626 Adelai	de St W, To	ronto, ON	June 10, 202	24				www.carso	ndunlop.com		
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR		
OUR ADVICE	APPENDIX	REFERENCE									

# Description

General: • The asphalt shingles are less than 5 years old

# Sloped roofing material:

Asphalt shingles





Asphalt shingles

# **Observations and Recommendations**

# **RECOMMENDATIONS \ General**

Condition: • No roofing recommendations are offered as a result of this inspection.

# Inspection Methods and Limitations

Inspection performed: • With camera on extension pole

Age determined by: • Seller

# TERIOR

# Report No. 88685

626 Adelaide St W, Toronto, ON June 10, 2024 www.carsondun									ndunlop.com
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE							
Description									

Wall surfaces and trim: • Brick • Wood

# **Observations and Recommendations**

# **ROOF DRAINAGE \ Downspouts**

Condition: • As of Dec 2016, a Toronto by-law requires downspouts to discharge above grade. Exemptions may be available in some cases. Below-grade downspouts may leak or be clogged, resulting in basement leakage. Click the line above for details.

Location: Various

Task: Improve -or- request exemption from city

Time: As required



Ex: Below-grade discharge noted

# WALLS \ Wood siding

Condition: • Paint or stain - needed Location: Rear Task: Improve Time: Regular Maintenance

EXTER 626 Adelai	<b>IOR</b> de St W, To	ronto, ON	June 10, 202	24				•	No. 88685 ndunlop.com
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE	1						
							J177		



Ex: Paint or stain

# GARAGE \ Ceilings and walls

Condition: • Not gastight Task: Improve Time: As soon as practical Cost: Minor



Ex: Seal opening



Ex: Seal opening

EXTER	EXTERIOR Report No. 88685								
626 Adelaide St W, Toronto, ON June 10, 2024									ndunlop.com
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE							

# Inspection Methods and Limitations

Inspection limited/prevented by: • Storage in garage

Exterior inspected from: • Ground level

STRUCTURE	Report No. 88685
626 Adelaide St W, Toronto, ON June 10, 2024	www.carsondunlop.com
OVERVIEW ROOFING EXTERIOR STRUCTURE ELECTRICAL HEATING COOL	ING INSULATION PLUMBING INTERIOR
OUR ADVICE APPENDIX REFERENCE	
Description	
Configuration:     Slab-on-grade	
Foundation material: • Poured concrete • Masonry block	
Floor construction: • Joists • Concrete	
Exterior wall construction: • Wood frame	
Roof and ceiling framing:	
Trusses	

# **Observations and Recommendations**

Roof Trusses

# **RECOMMENDATIONS \ General**

**Condition:** • Most foundation walls and masonry walls have small cracks due to minor shrinkage, settlement or shifting. These will not be individually noted, unless leakage or building movement is noted.

# FLOORS \ Concrete slabs

**Condition:** • Concrete basement, crawlspace and garage floors are not typically part of the structure. Almost all basement, crawlspace and garage concrete floors have minor shrinkage and settlement cracks.

# Inspection Methods and Limitations

Attic/roof space: 
 Inspected from access hatch

ELECT 626 Adelai	<b>RICAL</b> de St W, To	ronto, ON	June 10, 202	24				-	No. 88685 ndunlop.com
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE							
Descrip	tion								
Service siz	<b>ze: •</b> 100 Ar	mps (240 Vo	lts)						
	on panel typ - utility room	e and locat	ion:						

Breaker panel (cover removed for inspection)

Distribution wire (conductor) material and type: • Copper - non-metallic sheathed • Copper - metallic sheathed Circuit interrupters: Ground Fault (GFCI) & Arc Fault (AFCI): • GFCIs present • No AFCI

# **Observations and Recommendations**


# **RECOMMENDATIONS \ General**

**Condition:** • All electrical recommendations are safety issues. Treat them as high priority items, and consider the Time frame as Immediate, unless otherwise noted.

# SERVICE BOX, GROUNDING AND PANEL \ Distribution fuses/breakers

Condition: • Double taps Task: Improve Cost: Minor

Report No. 88685 **ELECTRICAL** www.carsondunlop.com 626 Adelaide St W, Toronto, ON June 10, 2024 ROOFING APPENDIX REFERENCE

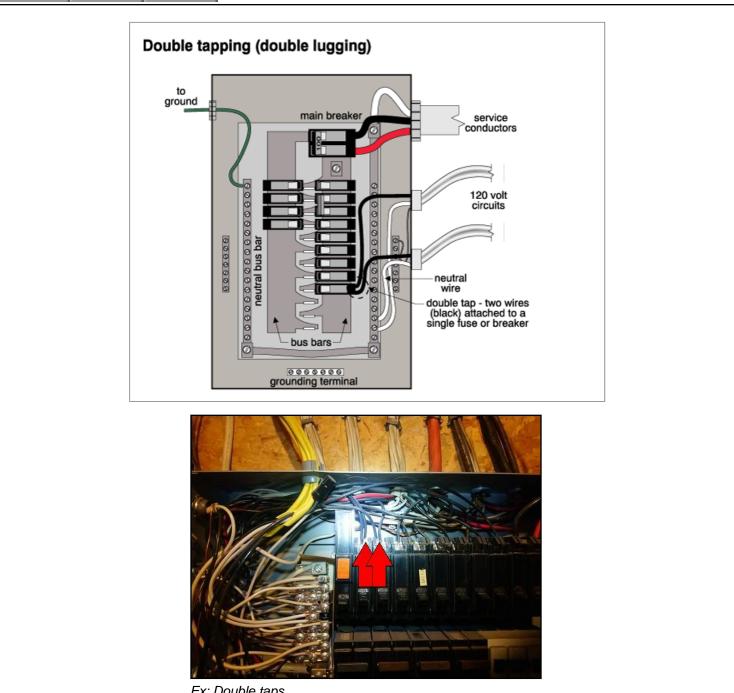

Ex: Double taps

Condition: • Fuses or breakers too big

- Some equipment/appliances (single load circuit) are permitted to be "overfused"; this needs to be verified by an electrician

Task: Improve

Cost: Minor

ELECTRICAL 626 Adelaide St W, To		Report No. 88685 www.carsondunlop.com
OVERVIEW ROOFING	EXTERIOR STRUCTURE ELECTRICAL HEATING COOLING INSUL	ATION PLUMBING INTERIOR
OUR ADVICE APPENDIX	REFERENCE	

3

Breaker too big (?)

# **COMMENTS \ Additional**

Condition: • Smoke alarm(s) old/expired Location: Various Task: Replace Cost: Minor

Condition: • Carbon monoxide alarm(s) missing
Location: Immediately outside all sleeping areas (ex: upper level hall)
Task: Provide
Cost: Minor

HEATI	NG							Report	t No. 88685
	ide St W, To	oronto, ON	June 10, 202	24				www.cars	ondunlop.com
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE							
Descrip	otion								
Heating s	ystem type:	• Furnace							
Fuel/energ	gy source:	• Gas							
Approxim	ate capacit	<b>y: •</b> 70,000 E	3TU/hr						
Efficiency	<b>/:</b>								
<ul> <li>High-effic</li> </ul>	ciency								
				4		A CONTRACTOR AND	NAME OF COMMANDER (*) VERTER STANDARDER FAN AMARKAMT (*) VERTER STANDARDER FAN AMARKAMT (*) VERTER STANDARDER (*) 19 MARC STANDARDER (*) 19 MARC STANDARDER FANNE (*) 19 MARC STANDARDER FANNE (*) 19 MARC STANDARDER (	0) 10.0/1.5	Contral Politician Contract to Source Politicians Int. Strong of Politicians X EMISSION (og/J) ELECTRICAL RATIN VOLTS HERTZ P 120 60

High-efficiency gas furnace

Data plate

LENNOX DALLAS, TEXAS

Approximate age: • 7 years Typical life expectancy: • Furnace (high efficiency) 15 to 20 years Chimney/vent: • Metal

# **Observations and Recommendations**

# **RECOMMENDATIONS \ General**

**Condition:** • No heating recommendations are offered as a result of this inspection.

24" / 3/4

M/N SLP98UH070XV36B-09 S/N 5917L16471

# <complex-block> COCLING & HEAT PUMP Bog to A delaide St W, Toronto, ON June 10, 2024 Www.carsondulop.com OVERVIEW ROOFING EXTERIOR ELECTRICAL HEATING COCLING RUMUBIC INTERIOR OUR ADVICE APPENDIX REFERENCE Description Another interior Another interior Contractioning type: - Contractioning type: (Interior interior interinterior interior interior interinterior interinterior

Air cooled condenser

Data plate

Cooling capacity: • 24,000 BTU/hr

Compressor approximate age: • 10 years


Typical life expectancy: • 10 to 15 years

# **Observations and Recommendations**

# AIR CONDITIONING \ Life expectancy

Condition: • Air conditioner near the end of typical life expectancy - Continue to operate until replacement is necessary Task: Replace Time: When necessary Cost: \$3,000 - \$6,000

<b>INSULATION</b> 626 Adelaide St W, To		NTILATI June 10, 202					-	No. 88685 ondunlop.com
OVERVIEW ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE APPENDIX	REFERENCE							
Description								
Attic/roof insulation r • Fiberglass Attic/roof insulation a	Fibe	erglass attic in	sulation					
Observations an	d Recom	mendatio	ne					
ATTIC/ROOF \ Hatch/ Condition: • Not weat Task: Improve Time: If desired Cost: Minor	<u>Door</u>	mondatic						

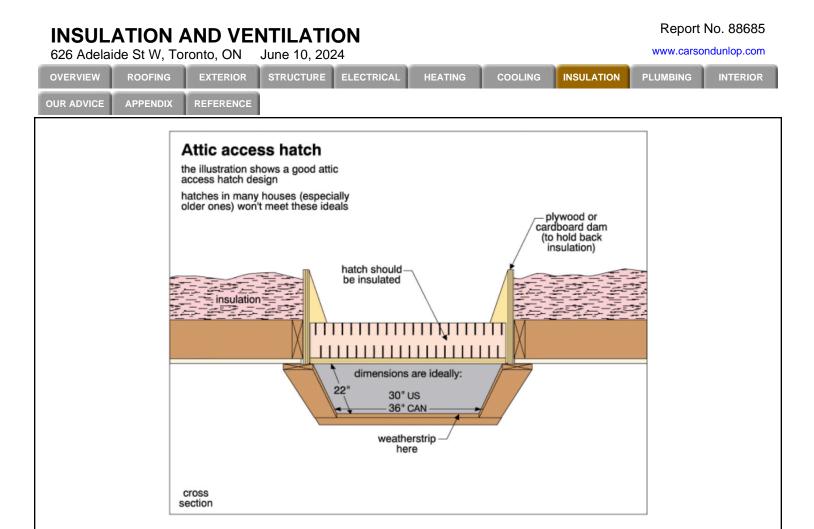

# Inspection Methods and Limitations

Inspection limited/prevented by lack of access to: • Wall space - access not gained.

Attic inspection performed: • From access hatch

Roof ventilation system performance: 
 Not evaluated

PLUMBING 626 Adelaide St W, Toronto, ON June 10, 2024	Report No. 88685 www.carsondunlop.com
OVERVIEW ROOFING EXTERIOR STRUCTURE ELECTRICAL HEATING COOLING INSULATION	PLUMBING INTERIOR
OUR ADVICE APPENDIX REFERENCE	
Description	
<text><text><section-header><text><text></text></text></section-header></text></text>	
Water heater type:	
• Tank	
BOSOSADES2 Midl - Midde BSST7 U2009 F703214 For Lipser	ATIC STORAGE WATER HEATER

Water heater

Water heater fuel/energy source: • Gas Water heater tank capacity: • 189 liters/50 US gallons

For closet or alcove installation. Not for installation in a mobile home. A0000 Entrée ra -4500 Annude(m): 0-1371 Do not connect to any heating system or component(s) previously used with nonpotable water heating appliance. Toxic chemicals, such as used for boiler treatment must not be introduced not he potable water heater used for space cuperation USgih@100F Lihasso c d d his appliance must be installed in accordance aith local codes. In the absence of local codes (SA B149.1 must be used. Europey and An Bives it must be been Exergined with a control which has a built in ECO temps of the temps of the period of the temps of tem 00 COL D'A

Data plate

# PLUMBING

# Report No. 88685

www.carsondunlop.com

626 Adelaide St W, Toronto, ON June 10, 2024

		,							
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE							

# Water heater approximate age: • 12 years

Water heater typical life expectancy: • 10 to 15 years

Waste and vent piping in building: • Plastic

Pumps: • None

Floor drain location: • Near heating system

Floor drain location: • Ground level bathroom

# **Observations and Recommendations**

# WATER HEATER \ Life expectancy

Condition: • Near end of life expectancy

- New tank (similar type and size) can be purchased for \$1,200 to \$2,400. Rental tank can be obtained for minimal/no cost and carried for a monthly fee. Seller reports current unit is a rental; contact rental provider for more information when necessary.

Task: Replace

Time: When necessary

# WASTE PLUMBING \ Drain piping - performance

**Condition:** • The main sewer line to the street cannot be inspected during a home inspection. A video scan dramatically reduces the risk of expensive and unhealthy sewer back-ups.

Task: Provide after possession of the home.

**Cost**: \$300

# Inspection Methods and Limitations

Items excluded from a building inspection: • Tub/sink overflows

# Report No. 88685 www.carsondunlop.com

626 Adelaide St W, Toronto, ON June 10, 2024

ROOFING EXTERIOR STRUCTURE ELECTRICAL HEATING COOLING INSULATION PLUMBING INTERIOR

APPENDIX REFERENCE

# **Observations and Recommendations**

# **CEILINGS \ General notes**

Condition: • Patched

- Tested dry with moisture meter. Seller reports prior leak that has since been repaired. No further action required. **Location**: Dining Room

Task: Monitor

Time: Ongoing





Patched

STAIRS \ Handrails and guards

Condition: • Incomplete or not continuous railing Location: Upper Level Task: Improve Time: For personal safety



Handrail incomplete / not continuous

Powered by Knowledge

# INTERIOR

# Report No. 88685

 626 Adelaide St W, Toronto, ON
 June 10, 2024
 www.carsondunlop.com

 OVERVIEW
 ROOFING
 EXTERIOR
 STRUCTURE
 ELECTRICAL
 HEATING
 COOLING
 INSULATION
 PLUMBING
 INTERIOR

 OUR ADVICE
 APPENDIX
 REFERENCE
 ELECTRICAL
 HEATING
 COOLING
 INSULATION
 PLUMBING
 INTERIOR

# Inspection Methods and Limitations

Percent of foundation not visible: • 99 %

 OUR ADVICE
 Report No. 88685

 626 Adelaide St W, Toronto, ON
 June 10, 2024

 overview
 ROOFING
 EXTERIOR

 STRUCTURE
 ELECTRICAL
 HEATING
 COOLING
 INSULATION
 PLUMBING
 INTERIOR

 OUR ADVICE
 APPENDIX
 REFERENCE
 Vertical
 V

# Description

**OUR ADVICE FOR LOOKING AFTER YOUR HOME:** • Home maintenance is an important responsibility. It protects your investment, extends life expectancy and helps avoid significant expenses. This document is an integral part of the report, and will help you avoid many common problems and reduce costs.

**Priority Maintenance and Home Set-Up:** • The Home Set-Up and Maintenance chapter in the Home Reference Book provides important information regarding things that are done once when moving in, as well as regular maintenance activities.

Please be sure to follow these maintenance guidelines. The Home Reference Book is included under the REFERENCE tab in this report.

**Basement/Crawlspace Leakage:** • Basement water leakage is the most common problem with homes. Almost every basement and crawlspace leaks under the right conditions. Good maintenance of exterior grading, gutters and downspouts is critically important.

For more details, please refer to Section 10 of the Interior chapter of the Home Reference Book, which is in the REFERENCE tab in this report.

**Roof - Annual Maintenance: •** It is important to set up an annual inspection and tune-up program to minimize the risk of leakage and maximize the life of the roof. Roof leaks may occur at any time and are most often at penetrations or changes in material. A leak does not necessarily mean the roof needs to be replaced.

Roof coverings are disposable and have to be replaced from time to time. Asphalt shingles, for example, last roughly 15 years.

**Exterior - Annual Maintenance:** • Annual inspection of the exterior is important to ensure weather-tightness and durability of exterior components. Grading around the home should slope to drain water away from the foundation to help keep the basement dry.

Painting and caulking should be well maintained. Particular attention should be paid to horizontal surfaces where water may collect.

Joints, intersections, penetrations and other places where water may enter the building assembly should be checked and maintained regularly.

**Garage Door Operators:** • The auto reverse mechanism on your garage door opener should be tested monthly. The door should also reverse when it meets reasonable resistance, or if the 'photo eye' beam is broken.

**Electrical System - Label the Panel:** • Each circuit in the electrical panel should be labelled to indicate what it controls. This improves both safety and convenience. Where the panel is already labelled, the labelling should be verified as correct. Do not rely on existing labeling.

**Ground Fault Circuit Interrupters and Arc Fault Circuit Interrupters:** • These should be tested monthly using the test buttons on the receptacles or on the breakers in the electrical panel.

**Heating and Cooling System - Annual Maintenance:** • Set up an annual maintenance agreement that covers parts and labour for all heating and cooling equipment. This includes gas fireplaces and heaters, as well as furnaces, boilers and air conditioners. Include humidifiers and electronic air cleaners in the service agreement. Arrange the first visit as soon as possible after taking possession.

OUR A	DVICE							Report	No. 88685
	ide St W, To	ronto, ON	June 10, 202	24				www.carso	ndunlop.com
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE							

Check filters for furnaces and air conditioners monthly and change or clean as needed. Duct systems have to be balanced to maximize comfort and efficiency, and to minimize operating costs. Adjust the balancing for heating and cooling seasons, respectively.

For hot water systems, balancing should be done by a specialist to due to the risk of leakage at radiator valves. These valves are not operated during a home inspection. • Check filters for furnaces and air conditioners monthly and change or clean as needed. Duct systems have to be balanced to maximize comfort and efficiency, and to minimize operating costs. Adjust the balancing for heating and cooling seasons, respectively. • For hot water systems, balancing should be done by a specialist due to the risk of leakage at radiator valves. These valves are not operated during a home inspection.

**Bathtub and Shower Maintenance:** • Caulking and grout in bathtubs and showers should be checked every 6 months, and improved as necessary to prevent leakage and water damage behind walls and below floors.

**Water Heaters:** • All water heaters should be flushed by a specialist every year to maximize performance and life expectancy. This is even more critical on tankless water heaters.

**Washing Machine Hoses:** • We suggest braided steel hoses rather than rubber hoses for connecting washing machines to supply piping in the home. A ruptured hose can result in serious water damage in a short time, especially if the laundry area is in or above a finished part of the home.

**Clothes Dryer Vents:** • We recommend that vents for clothes dryers discharge outside the home. The vent material should be smooth walled (not corrugated) metal, and the run should be as short and straight as practical. This reduces energy consumption and cost, as well as drying time for clothes. It also minimizes the risk of a lint fire inside the vent.

Lint filters in the dryer should be cleaned every time the dryer is used. There is a secondary lint trap in many condominiums. These should be cleaned regularly. There may also a duct fan controlled by a wall switch. The fan should be ON whenever the dryer is used.

Dryer ducts should be inspected annually and cleaned as necessary to help reduce the risk of a fire, improve energy efficiency and reduce drying times.

**Fireplace and Wood Stove Maintenance:** • Wood burning appliances and chimneys should be inspected and cleaned before you use them, and annually thereafter. We recommend that specialists with a WETT (Wood Energy Technology Transfer, Inc.) designation perform this work. Many insurance companies require a WETT inspection for a property with a wood burning device.

**Smoke and Carbon Monoxide (CO) Detectors/Alarms:** • Smoke detectors are required at every floor level of every home, including basements and crawlspaces. Even if these are present when you move into the home, we recommend replacing the detectors. We strongly recommend photoelectric smoke detectors rather than ionization type detectors. Carbon monoxide detectors should be provided adjacent to all sleeping areas.

These devices are not tested during a home inspection. Detectors should be tested every 6 months, and replaced every 10 years. Batteries for smoke and carbon monoxide detectors should be replaced annually. If unsure of the age of a smoke detector, it should be replaced.

**Backwater Valve:** • A backwater valve protects your home from a backup of the municipal sewer system. The valve may be equipped with an alarm to notify you of a backup. Please note: if the valve is closed due to a municipal sewer backup, you cannot use the plumbing fixtures in the home. The waste water is unable to leave the building and will back up through floor drains and the lowest plumbing fixtures.

OUR A	OUR ADVICE								
	ide St W, To	ronto, ON	June 10, 202	24				www.carso	ndunlop.com
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE							

• The valve should be inspected and cleaned as necessary at least

twice a year.

**Sump Pump:** • A sump pump collects storm water below the basement floor and discharges it safely to the exterior to prevent flooding. The discharge point should be at least 6 feet (2 m) away from the home. Best installations include backup power for the sump pump, so it will work in the event of a power outage. A high water alarm in the sump pump will notify you if the pump fails. Some installations include a backup pump.


The sump and pump should be inspected and tested four times a year.


**For condominium owners:** • Condominium owners - Maintenance and Repairs: There are two types of repairs that may be performed in a condo - repairs to an individual condo unit and repairs to common elements. Common elements are set out in the Condominium Declaration and will differ from one building to another. If repairs must be made inside your unit, you are responsible for making the repairs at your own expense. You are also responsible for the ongoing maintenance of your unit. The condominium corporation's board of directors is responsible for maintenance and repair of the common elements. Exclusive-use common elements, such as parking spaces or balconies are generally maintained by the condominium board.

Be Ready for Emergencies: Be sure you know where to shut off the water. Some condos have more than one shut off, and others need a special tool (key) to turn off water. Label each circuit on the electrical panel, and make sure you should know how to turn off the power. Keep a fire extinguisher suitable for grease fires near the kitchen.

Property Manager and Concierge/Security: Keep the contact information for these folks handy (perhaps on your phone) wherever you are. • Lint filters in the dryer should be cleaned every time the dryer is used. There is a secondary lint trap in many condominiums. These should be cleaned regularly. There may also a duct fan controlled by a wall switch. The fan should be ON whenever the dryer is used.

# END OF REPORT

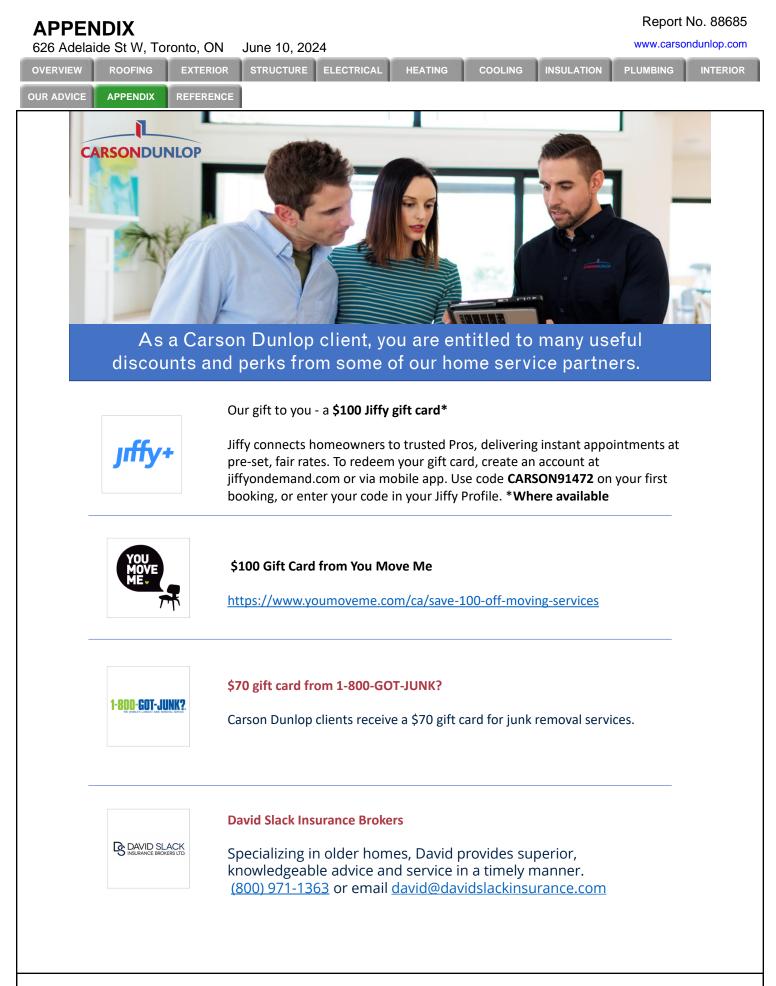

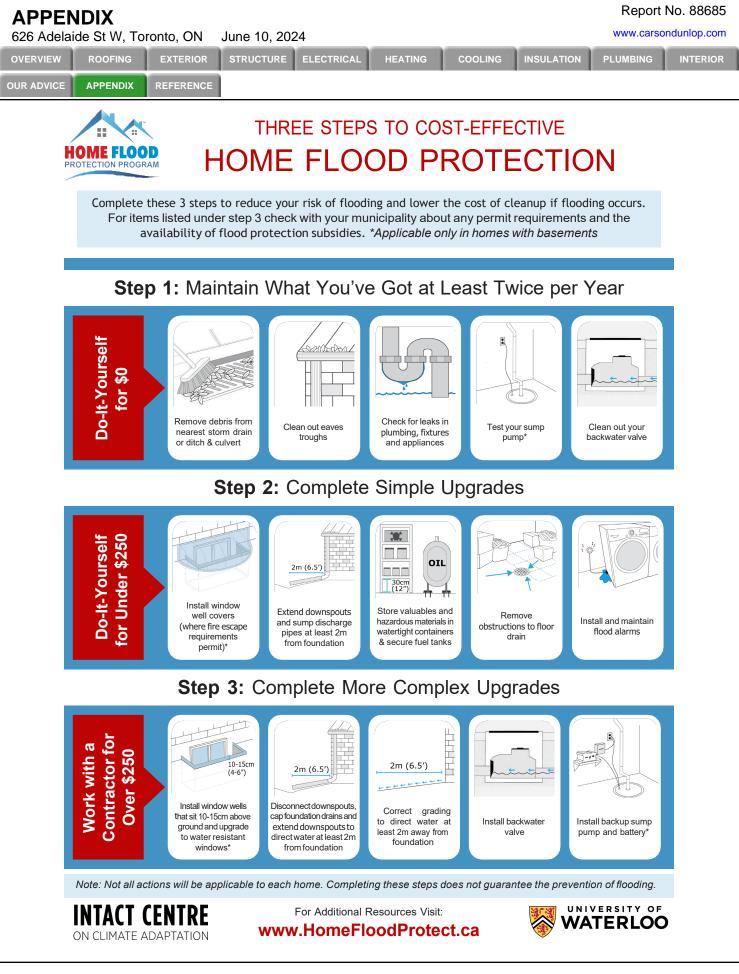

Powered by Knowledge

APPENDIX	Report No. 88685
626 Adelaide St W, Toronto, ON June 10, 2024 OVERVIEW ROOFING EXTERIOR STRUCTURE ELECTRICAL HEATING COOLING INSULATION	PLUMBING INTERIOR
OUR ADVICE APPENDIX REFERENCE	
Basement Flood Protection Check	klist
Take these steps to reduce your risk of basement flooding and reduce the cost of cleaning up after Remember to check with your municipality about the availability of basement flood protection su Check with your insurer about discounts for taking action to reduce flood risk.	
1. Maintain Your Home's Flood Protection Features at Least Twice Per Year	r
SPRING       FALL         Remove debris from nearest storm drain         Clean out eaves troughs         Test sump pump(s) and backup power source         Clean out backwater valve         Maintain plumbing, appliances and fixtures         Test flood alarms	
2. Keep Water Out of Your Basement	
<ul> <li>Correct grading to direct water at least 2m away from your foundation</li> <li>Extend downspouts and sump discharge pipes to direct water at least 2m a from your foundation or to the nearest drainage swale</li> <li>Install window well covers</li> <li>Install window wells that are 10-15cm above the ground and are sealed at t foundation</li> <li>Install water-resistant basement windows</li> <li>Install a backwater valve (work with a plumber and get required permits)</li> </ul>	
3. Prepare to Remove Any Water from Your Basement as Quickly as Possible	
Remove obstructions to the basement floor drain Install a back-up sump pump and power source	
4. Protect Personal Belongings in Your Basement	
Store valuables in watertight containers or remove Store hazardous materials (paints, chemicals) in watertight containers or ren Raise electronics off the floor Select removable area rugs and furnishings that have wooden or metal leg	
Note: Not all actions will be applicable to each home. Completing these steps does not guarantee the prevention of ba	
INTACT CENTRE ON CLIMATE ADAPTATION       For Additional Resources Visit:         WWW.HomeFloodProtect.ca	TERLOO

Powered by Knowledge

APPEN	IDIX				Report No. 88685
	de St W, To	ronto, ON	June 10, 2024		www.carsondunlop.com
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE ELECTR	ICAL HEATING COOLING INSU	JLATION PLUMBING INTERIOR
OUR ADVICE	APPENDIX	REFERENCE			
	THIS C COMP		ITS THE LIABILITY OF THE	HOME INSPECTOR AND THE HOME INSPEC	TION
	PLEAS	E READ CAREF	ULLY BEFORE ACCEPTING.		
	Carsoı ("Insp Home	n, Dunlop & As pection") is per and Property	ssociates Ltd. ("CD"), the h formed in accordance witl Inspectors (the "Standard	ocument means, collectively, the home insome inspection company. The home inspection company. The home inspective Standards of Practice of the Canadian "). We recommend that you review the Stards, click <u>CAHPI 2023 National Standards</u>	ction Association of andards before
	1) PUF	RPOSE AND LIN	MITATIONS		
			ort (the "Report") is an opi of the readily accessible fea	ion of the present condition of the proper tures of the building.	rty based on a
	review mecha perfor	w, rather than a anical, electrica	a design review. The Inspe al, and structural systems, ering, architectural, plumb	alist. The Inspection is a non-invasive perf ctor does not perform calculations to dete for example, are properly sized. The Inspe ing or electrical services or assessments th	rmine whether ctor will not
				nditions that are normally outside the scopes not change the scope of the Inspection	
			itations are not clear, we ccepting and before the in	encourage you to contact the Inspector to spection.	discuss the
	2) THE	E INSPECTION I	IS NOT TECHNICALLY EXHA	USTIVE	
	we typ not all Establ	pically come ac I issues will be lishing the sign	cross some smaller issues. identified. Cosmetic and	t technically exhaustive. While looking for These may be included in the Report as a c other non-critical items are not part of the beyond the scope of the Inspection. Furth ost.	courtesy, but Inspection.
	inform	nation than an	Inspection. We have both	ly exhaustive inspection of the home that services available. By accepting and signin losen an Inspection instead of a Technical	ig this
			l about any conditions not for a more detailed analy	ed in the Report, we strongly recommend - is.	that you consult
	3) TH	E INSPECTION	IS AN OPINION OF THE PR	ESENT CONDITION OF THE VISIBLE COMPO	DNENTS
	deficie	encies may be		conditions on the date and time of the Ins conditions, inoperable systems, inaccessibi	
	RLS:004	75320.1			

APPENDIX				Report No. 88685
626 Adelaide St W, To	oronto, ON	June 10, 2024		www.carsondunlop.com
OVERVIEW ROOFING	EXTERIOR	STRUCTURE ELECTRICAL	HEATING COOLING INSUL	ATION PLUMBING INTERIOR
OUR ADVICE APPENDIX	REFERENCE			
Δn In	spection does I	NOT include or identify defects	hat are hidden behind walls, floors, cei	ilings storage
furnit struct	ture, etc. This ir ture, plumbing	ncludes inaccessible elements si	uch as, but not limited to, wiring, heatir ot remove wall coverings (including wal	ng, cooling,
circui			ection because they only happen unde discover leaks that occur only during ce	
but is	s not limited to, otacles, switche	roofing, siding, masonry, caulk	ere there are several similar items. Thi ng, windows, interior doors, electrical v d air/vapor barriers, and floor, wall, an	wiring,
4) TH	IIS IS NOT A COI	DE-COMPLIANCE INSPECTION		
electi	rical codes, fue	codes, fire codes, regulations,	complies with past or present building aws, by-laws, ordinances, or other regu mes do not comply with current codes.	ulatory
5) TH	IE INSPECTION I	DOES NOT INCLUDE HAZARDOU	S MATERIALS	
phen insula insula	ol-formaldehyd ation. Inspector ation, fireproof	e and urea-formaldehyde base s do NOT identify asbestos in ro ng, etc. Inspectors do NOT look	that are suspected of posing a risk to h d insulation, fiberglass insulation and ve ofing, siding, wall, ceiling or floor finish for lead or other toxic metals. Environ idditional cost, should concerns exist.	ermiculite nes,
		not address environmental haz s or termite treatments.	ards such as the past use of insecticides	s, fungicides,
6) TH	IE INSPECTION I	DOES NOT ADDRESS MOULD AN	D THE AIR QUALITY IN A BUILDING	
		NOT address irritants, pollutan es, for example, spores, fungus	s, contaminants, or toxic materials in o mould, or mildew.	r around the
		t whenever there is water dama behind a wall, floor, or ceiling.	ge, there is a possibility that mould or i	mildew may
wate	r penetration is	sues noted in the Report, we st	shtened sensitivity to quality of air, or it rongly recommend that you consult a q terials, mould and allergens at an addit	qualified
7) TH	HE INSPECTION	DOES NOT INCLUDE BURIED TA	NKS	
may l respo burie	be buried on th onsible for their ed tank, we stro	e property. If there are fuel oil or removal and the safe disposal of	for identifying, fuel oil, septic or gasoli or other storage tanks on the property, of any contaminated soil. If you suspect n a qualified Environmental Consultant,	you may be t there is a
RLS:004	475320.1			

APPEN		eport No. 88685 w.carsondunlop.com
626 Adelaid	le St W, Toronto, ON June 10, 2024 WWV ROOFING EXTERIOR STRUCTURE ELECTRICAL HEATING COOLING INSULATION PLUMI	
OUR ADVICE	APPENDIX REFERENCE	
	8) CANCELLATION FEE	
	If the Inspection is cancelled within 24 hours of the appointment time, a cancellation fee of 50% of the fee will apply.	
	9) THERMAL IMAGING (If included with this Inspection)	
	The use of a thermal imager by your Inspector (which you can purchase for an extra cost) is for the purpose of screening for potential water issues. While the use of this equipment improves the odds of detecting a moisture issue, it is not a guarantee, as numerous conditions can mask the thermal signature of moisture. Thermal imaging will not detect all moisture issues behind walls, ceilings, or furniture. Additionally, water leakage is often intermittent, and cannot be detected when not present.	
	10) MOULD ASSESSMENT (If included with this Inspection)	
	The services provided in this optional assessment (which you can purchase for an extra cost) include a visual inspection for signs of water intrusion and mould growth. Moisture readings will be collected. Two indoor air samples and one outdoor reference sample will be collected. Should visible mould growth be identified, one surface sample will be collected. The results of the sample and investigation will be summarized in a written Report.	
	The mould assessment will not be able to detect or identify all mould that may be present in the home, including that which is hidden behind walls, floors, ceilings, storage, or furniture.	
	11) REPORT IS FOR OUR CLIENT ONLY	
	The Report is for the exclusive use of the client named herein and their real estate agent if applicable and will not be released to others without the client's consent. No use of, or reliance on, the Report or any information contained in the Report by any other party is intended. The client agrees that the Report will not be shared or distributed to third parties, except to prospective buyers of the property in the case of a pre-listing inspection.	
	NOTE: If you do not want your real estate agent to receive a copy of the report, please let us know at 416-964-9415 or <a href="mailto:inspection@carsondunlop.com">inspection@carsondunlop.com</a> .	
	12) NOT A GUARANTEE, WARRANTY, OR INSURANCE POLICY	
	The Inspection and Report are NOT a guarantee, warranty, or an insurance policy on the condition, future use, operability, habitability or suitability of the home or its components.	
	Given the limitations to the visual Inspection, the Inspector is neither responsible nor liable for the non- discovery of any patent or latent defects, or other conditions which may occur or may become evident after the date and time of the Inspection.	
	13) TIME TO INVESTIGATE	
	The Inspector will have no liability for any claim or complaint if conditions have been disturbed, altered, repaired, replaced, or otherwise changed before the Inspector has had reasonable time to investigate.	
	RLS:00475320.1	

APPEN								Report No. 88685
626 Adelai	de St W, To ROOFING	ronto, ON EXTERIOR	June 10, 202 STRUCTURE			COOLING		www.carsondunlop.com
	APPENDIX	REFERENCE	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING INTERIOR
	APPENDIX	REFERENCE						
	14) LII	VIT OF LIABILIT	Y/INDEMNITY					
			eement, you exp				IABILITY OF THE NS WITH RESPECT	TO
	THE IN	ISPECTOR'S INS	SPECTION AND R	EPORT, FOR AN	IY CAUSE OF AC	CTION WHATS	OEVER, WHETHER	RIN
			(INCLUDING NEC THIS INSPECTION				FEES THAT YOU F	HAVE
			ify and hold the				oloyees, agents, , liabilities, judgen	nents
	losses	and expenses,	including legal for	ees and expens	es, brought aga	ainst or involvi	ing the Inspector t	that
		to or arise out , damages, or l	•	n or the Report	whether indire	ect, consequer	ntial, punitive or s	pecial
						-	to the Inspection	or the
	Furthe	er, you agree to	allow the Inspe	ctor the opport	unity to re-insp	pect the claim	lays of discovery. ed discrepancy, ex	
							he claimed discrep shall constitute a	
	waive	r of all claims tl	nat you may have	e against the In	spector.			
			lause may be alt nent must be in		-		Inspector and the	9
	15) TII	ME PERIOD						
	the In:	spector for dan	nages suffered b	y you as a resul	t of alleged err	ors, omissions	eedings by you ag s, breaches of cont late of the Inspect	tract
	16) PR	IVACY/USE OF	PERSONAL INFO	RMATION				
							information only	
							ay be accessed at v this document b	
	signin	g this Agreeme	nt and providing	your personal	information to	the Inspector	and CD.	
			ollect data which d. but may also c				g to the visual inspected, client	
	and/o	r client represe	ntative personal	and contact in	formation, and	demographic	data. The Inspect	
							rove the CD inspe ector confirms th	
	collect	tion and use of	this data and ce	rtain personal i	nformation is fo	or the followir	ng purposes:	
	•		ou with informat ducts, services ar				efits that you req	uest
					,			
	RLS:004	75320.1						

		hur - 40, 0004				•	No. 88685 ndunlop.com
OVERVIEW	le St W, Toronto, ON	June 10, 2024 STRUCTURE ELECTRICA	L HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX REFERENCE						
		rends and patterns related to ction industries and to provide	-				
	value-added services collected data, indivi property address, en parties. Other than in	nd others. ector may provide collected d to clients, as described in thi dual collected data and/or co nail addresses, phone number nteraction with TPSPs, aggreg n, the Inspector will not sell or	s Agreement. The l llected personal in rs, appliance inform ated data, individu	Inspector may p formation (inclu nation and prop al collected dat	provide aggrega uding name, perty data) to th a and/or collect	ted ird	
	By executing this Ag	ny third party except as nece reement, you confirm that you lescribed herein and in CD's P	a expressly consen		on and use of d	ata	
	If you DO NOT conse	nt to the Inspector providing out by emailing privacy@cars	collected data to T	PSPs for the pu	rpose describec	ł	
		nt to receiving future commu t-out by emailing <u>privacy@ca</u>		concerning its p	products and		
	17) LEGAL ADVICE						
	-	at you have either sought and lependent legal advice as you					
	18) CLIENT'S AGREEN	ЛЕNT					
	you have the author	agree to be bound by each pr ity to bind any other family m	embers or other in	nterested parties	s to this Agreen	nent.	
	will remain in effect. communications are set forth herein. No and signed by the Ins	any provision of this Agreeme This Agreement represents the merged into this Agreement, statement or promise of the lespector. No change or modific fication is in writing and signe	ne entire agreemen and there are no t nspector shall be b ation shall be enfo	nt between the erms or conditi oinding unless re	parties. All prio ons other than educed to writin	r those Ig	
	RLS:00475320.1						

APPEN	NDIX							Report	No. 88685
626 Adela	ide St W, To	ronto, ON	June 10, 202	24				www.carso	ndunlop.com
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE							



# Canadian Association of Home & Property Inspectors

# **2023 National Standards of Practice**

The National Standards of Practice are for home and property inspectors to follow in the performance of their inspections. They are the most widely accepted Canadian home and property inspection Standards in use and address all the home's major systems and components as listed in this Standard. The National Standards of Practice and Code of Ethics are recognized by many related professionals as the definitive standards for professional performance in the industry.

These National Standards of Practice are being published to inform the public on the nature and scope of visual building inspections performed by home and property inspectors who are members of the Canadian Association of Home & Property Inspectors (CAHPI).

The purpose of the National Standards of Practice is to provide minimum requirements for home and property inspectors regarding both the inspection itself and the inspection report, and to define certain terms relating to the performance of home or property inspections to ensure consistent interpretation.

These standards take into account that a visual inspection of a building does not constitute an evaluation or a verification of compliance with building codes, standards or regulations governing the construction industry or the health and safety industry, or standards and regulations governing insurability.

2

2

2

# INDEX

1.	Introduction
2.	Purpose and Scope
3.	General Limitations and Exclusions
4.	Structural Systems
5.	Exterior Systems
6.	Roof Systems
7.	Plumbing Systems
8.	Electrical Systems
9.	Heating Systems
10.	Fireplaces & Solid Fuel Burning Appliances
11.	Air Conditioning Systems
12.	Interior Systems
13.	Insulation and Vapour Retarders
14.	Mechanical and Natural Ventilation Systems
	Glossary

Any terms not defined in the glossary of this standard will use industry standard terms.

*Glossary Note: Italicized words are defined in the Glossary.* 

Report No. 88685 www.carsondunlop.com

626 Adelaide St W. Toronto. ON June 10. 2024

APPENDIX

OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE							

#### 1. INTRODUCTION

**1.1** The Canadian Association of Home & Property Inspectors (CAHPI) is a not-for-profit association. CAHPI strives to promote excellence within the profession and continual improvement of inspection services to the public.

#### 2. PURPOSE AND SCOPE

**2.1** The purpose of these National Standards of Practice is to establish professional and uniform Standards for home and property inspectors who are members of CAHPI. Home and Property Inspections performed to these National Standards of Practice are intended to provide information regarding the condition of the systems and components of the building as observed at the time of the Inspection.

These National Standards of Practice apply to inspections of part or all of a building for the following building types:

- single-family dwelling, detached, semi-detached or row house
- multi-unit residential building
- · residential building held in divided or undivided co-ownership
- residential building occupied in part for a residential occupancy and in part for a commercial occupancy, as long as the latter use does not exceed 40% of the building's total area, excluding the basement.

#### 2.2 THE INSPECTOR SHALL:

#### A. inspect:

1. *readily-accessible*, visually-observable *installed systems*, and *components* of buildings listed in these National Standards of Practice.

#### B. report:

- 1. on those installed systems and components that, in the professional opinion or judgement of the *inspector*, have a significant deficiency, or are near the end of their service lives.
- 2. the implication for the system or component that has a significant deficiency or is near the end of its service life.
- 3. the inspector's recommendations to correct, repair, or refer for further evaluation of the reported deficiency by a qualified specialist.
- 4. on any *systems* and *components* designated for inspection in these National Standards of Practice which were known to be present at the time of the *Home or Property Inspection* but were not inspected and a reason they were not inspected.

#### 2.3 These National Standards of Practice are not intended to limit inspectors from:

- **A.** including other inspection services in addition to those required by these National Standards of Practice provided the *inspector* is appropriately qualified to do so.
- **B.** excluding *systems* and *components* from the inspection if requested by the client or as dictated by circumstances at the time of the inspection.

#### 3. GENERAL LIMITATIONS AND EXCLUSIONS

#### **3.1 GENERAL LIMITATIONS:**

- **A.** Inspections performed in accordance with these National Standards of Practice 1. are not *technically exhaustive*.
  - 2. will not identify concealed conditions or latent defects.

#### 3.2 GENERAL EXCLUSIONS:

**A.** The *inspector* is not required to perform any action or make any determination unless specifically stated in these National Standards of Practice, except as may be required by lawful authority.

APPEND 626 Adelaide	St W, Toronto, ON June 10, 2024	Report No. 88685
	ROOFING EXTERIOR STRUCTURE ELECTRICAL HEATING COOLING INSULATION	PLUMBING INTERIOR
	APPENDIX REFERENCE	
В.	<ul> <li>Inspectors are NOT required to determine:</li> <li>condition of systems or components which are not readily accessible.</li> <li>remaining service life of any system or component.</li> <li>strength, adequacy, effectiveness, or efficiency of any system or component.</li> <li>causes of any condition or deficiency.</li> <li>methods, materials, or costs of corrections.</li> <li>future conditions including, but not limited to, failure of systems and components.</li> <li>suitability of the property for any use.</li> <li>compliance with regulatory requirements (codes, regulations, laws, ordinances, etc.).</li> <li>market value of the property or its marketability.</li> <li>advisability of the purchase of the property.</li> <li>presence of potentially hazardous plants, animals or insects including, but not limited to we destroying organisms, diseases or organisms harmful to humans.</li> <li>presence of any environmental hazards including, but not limited to toxins, carcinogens, no contaminants in soil, water, and air.</li> <li>effectiveness of any system installed or methods utilized to control or remove suspected haz substances.</li> </ul>	oise, and
	<ol> <li>operating costs of systems or components.</li> <li>acoustical properties of any system or component.</li> <li>design adequacy with regards to location of the home or property, or the elements to which it</li> </ol>	is exposed.
C.	<ol> <li>Inspectors are NOT required to offer or perform:</li> <li>any act or service contrary to law, statute or regulation.</li> <li>engineering, architectural and technical services.</li> <li>work in any trade or any professional service other than home or property inspection.</li> <li>warranties or guarantees of any kind.</li> </ol>	
D.	<ul> <li><i>Inspectors</i> are NOT required to operate:</li> <li>any system or component which is shut down or otherwise inoperable.</li> <li>any system or component which does not respond to normal operating controls.</li> <li>shut-off valves.</li> </ul>	
E.	<ul> <li><i>Inspectors</i> are NOT required to enter:</li> <li>1. any area which will, in the opinion of the <i>inspector</i>, likely be hazardous to the <i>inspector</i> or o persons or damage the property or its <i>systems</i> or <i>components</i>.</li> <li>2. spaces which are not <i>readily accessible</i>.</li> </ul>	other
F.	<ul> <li>Inspectors are NOT required to inspect:</li> <li>1. underground items including, but not limited to, storage tanks or other indications of their presence, whether abandoned or active.</li> <li>2. systems or components which are not installed.</li> <li>3. decorative items.</li> <li>4. systems or components located in areas that are not readily accessible in accordance with the Standards of Practice.</li> <li>5. detached buildings.</li> <li>6. common elements or common areas in multi-unit housing, such as condominium/strata propr cooperative housing when inspecting individual units, including the roof and building envelop</li> <li>7. test and/or operate any fire alarm system, burglar alarm system, automatic sprinkler system fire protection equipment, electronic or automated installations, telephone, intercom, cable/ systems and any lifting equipment, elevator, freight elevator, wheelchair lift, climbing chair, es others;</li> <li>8. pools, spas and their associated safety devices.</li> </ul>	ese National perties, or pe. n or other internet
G.	<ul> <li>Inspectors are NOT required to:</li> <li>1. perform any procedure or operation which will, in the opinion of the <i>inspector</i>, likely be haze to the <i>inspector</i> or other persons or damage the property or its <i>systems</i> or <i>components</i>.</li> <li>2. move suspended ceiling tiles, personal property, furniture, equipment, plants, soil, snow, ice,</li> <li>3. dismantle any system or component.</li> </ul>	
2023	National Standards of Practice © Convright 2023 Canadian Association of Home & Property Inspectors, All Rig	hta Pagamiad

# 

# Report No. 88685 www.carsondunlop.com

626 Adelaide St W, Toronto, ON June 10, 2024

OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE							

#### 4. STRUCTURAL SYSTEMS

#### **4.1 THE INSPECTOR SHALL:**

- A. inspect:
  - 1. *structural components* including visible foundation and framing.
- B. report:
  - 1. methods used to *inspect* the *crawl space*.
  - 2. methods used to *inspect* the attics.

#### 5. EXTERIOR SYSTEMS

#### **5.1 THE INSPECTOR SHALL:**

- A. inspect:
  - exterior wall coverings, flashing and trim.
     all exterior doors.
  - 3. decks, balconies, stairs, porches, and their associated guards and handrails.
  - 4. eaves, soffits, and fascia where visible from the ground level.
  - 5. grading, and surface drainage.
  - 6. walkways, patios, and driveways.
  - 7. retaining walls and fences.
  - 8. attached garages or carports including garage doors and garage door operators.
- B. report:
  - 1. the methods used to inspect the exterior walls and their related components.

#### **5.2 THE INSPECTOR IS NOT REQUIRED TO:**

#### A. inspect:

- 1. screening, shutters, awnings, and similar accessories.
- 2. geological, geotechnical, or hydrological conditions.
- 3. recreational facilities.
- detached garages and outbuildings except as required by local authority with jurisdiction.
   mechanical lifts.
- 6. seawalls, breakwaters, dikes, and docks.
- 7. erosion control and earth stabilization measures.

#### 6. ROOF SYSTEMS

#### 6.1 THE INSPECTOR SHALL:

#### A. inspect:

- roof coverings.
- 2. roof drainage systems.
- flashings.
- 4. skylights, chimneys, and roof penetrations.

#### B. describe:

1. roof coverings.

#### C. report:

1. methods used to inspect the roofs.

# 6.2 THE INSPECTOR IS NOT REQUIRED TO:

# A. inspect:

- antennae and satellite dishes.
   interiors of flues or chimneys.
- other *installed* items attached to but not related to the roof systems.

#### 7. PLUMBING SYSTEMS

#### 7.1 THE INSPECTOR SHALL:

#### A. inspect:

- 1. interior water supply and distribution *systems* including all fixtures and faucets.
- 2. drain, waste and vent *systems* including all fixtures.
- 3. water-heating equipment and associated venting systems.
- 4. fuel storage and distribution systems.
- 5. drainage sumps, sump pumps, and related piping.
- 6. backflow preventers on supply piping.

#### B. describe:

- 1. water supply, distribution, drain, waste, and vent piping materials.
- 2. water heating equipment including the energy source.
- 3. location of main water and fuel shut-off valves.

#### 7.2 THE INSPECTOR IS NOT REQUIRED TO:

#### A. inspect:

- 1. clothes washing machine connections.
- 2. wells, well pumps, cisterns, or water storage related equipment.
- 3. water conditioning systems.
- 4. solar water heating systems.
- 5. fire sprinkler systems.
- 6. private waste disposal systems.
- 7. irrigation systems.

#### B. determine:

- 1. whether water supply and waste disposal *systems* are public or private.
- 2. the quantity or quality of the water supply.

#### C. operate:

1. safety valves or shut-off valves.

#### 8. ELECTRICAL SYSTEMS

#### **8.1 THE INSPECTOR SHALL:**

- A. inspect:
  - 1. service drop.
  - 2. service entrance conductors, cables, and raceways.
  - 3. service equipment and main disconnects.
  - 4. service grounding.
  - 5. interior components of service panels and sub panels.

Report No. 88685

626 Adelaide St W, Toronto, ON June 10, 2024

OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR

- REFERENCE
  - 6. distribution conductors.
  - 7. overcurrent protection devices.
  - 8. a representative number of installed lighting fixtures, switches, and receptacles.
  - 9. ground fault circuit interrupters (GFCI).
  - 10. arc fault circuit interrupters (AFCI).
  - 11. smoke alarms.
  - 12. carbon monoxide alarms.

#### **8.2 THE INSPECTOR IS NOT REQUIRED TO:**

#### A. inspect:

APPENDIX

APPENDIX

OUR ADVICE

- 1. remote control devices unless the device is the only control device.
- 2. alarm systems and components.
- 3. low voltage wiring, systems and components.
- 4. ancillary wiring, systems and components not a part of the primary electrical power distribution system.
- 5. telecommunication equipment.
- B. measure:
  - 1. amperage, voltage, or impedance.
- C. operate or test:
  - 1. smoke alarms.
  - 2. carbon monoxide alarms.

#### 9. HEATING SYSTEMS

#### 9.1 THE INSPECTOR SHALL:

- A. inspect:
  - 1. installed heating equipment.
  - 2. vent systems, flues, and chimneys.
  - 3. fuel storage and distribution systems.

#### 9.2 THE INSPECTOR IS NOT REQUIRED TO:

- A. inspect:
  - 1. interiors of flues or chimneys.
  - 2. heat exchangers.
  - 3. auxiliary equipment.
  - 4. solar heating systems.

#### **B.** determine:

1. system adequacy or distribution balance.

#### **10. FIREPLACES AND SOLID FUEL BURNING APPLIANCES**

#### **10.1 THE INSPECTOR SHALL:**

- A. inspect:
  - 1. fireplace and solid fuel burning system components.
  - 2. vent systems and chimneys.

B. describe:

1. fireplaces and solid fuel burning appliances.

#### **10.2 THE INSPECTOR IS NOT REQUIRED** TO:

#### A. inspect:

1. interior of flues or chimneys.

- 2.screens, doors and dampers.
- 3. seals and gaskets.
- 4. automatic fuel feed devices.
- 5. heat distribution systems whether fan-assisted or convection.
- B. ignite or extinguish fires or pilot lights.
- C. determine draft characteristics.
- D. move fireplace inserts, stoves, or firebox contents.

#### **11. AIR CONDITIONING SYSTEMS**

#### **11.1 THE INSPECTOR SHALL:**

- A. inspect
  - 1. permanently installed air conditioning equipment.

#### **11.2 THE INSPECTOR IS NOT REQUIRED TO:**

- A. inspect
  - 1. portable air conditioners.
- **B.** determine:
  - 1. system adequacy or distribution balance.

#### **12. INTERIOR SYSTEMS**

#### **12.1 THE INSPECTOR SHALL:**

- A. inspect:
  - 1. walls, ceilings, and floors.
  - 2. stairs, guards and handrails.
  - 3. a representative number of countertops and installed cabinets.
  - 4. a representative number of doors and windows.
  - 5. gas proofing of walls, doors and ceilings
  - separating the habitable spaces and the garage.
  - 6. fire separations.

#### **12.2 THE INSPECTOR IS NOT REQUIRED TO:** A. inspect:

- 1. decorative finishes.
- 2. window treatments.
- 3. central vacuum systems.
- 4. household appliances.
- 5. recreational facilities.

#### **13. INSULATION AND VAPOUR RETARDERS**

#### **13.1 THE INSPECTOR SHALL:**

- A. inspect:
- 1. insulation and vapour retarders.

#### **B.** describe:

1. type of insulation materials and vapour retarders in unfinished spaces.

#### **13.2 THE INSPECTOR IS NOT REQUIRED TO:** A. disturb:

- 1. insulation.
- 2. vapour retarders

2023 National Standards of Practice. © Copyright 2023 Canadian Association of Home & Property Inspectors. All Rights Reserved.

www.carsondunlop.com

#### Report No. 88685 APPENDIX www.carsondunlop.com 626 Adelaide St W, Toronto, ON June 10, 2024 PLUMBING

ROOFING STRUCTURE

INSULATION COOLING

OUR ADVICE REFERENCE APPENDIX

#### **14. MECHANICAL AND NATURAL VENTILATION SYSTEMS**

#### **14.1 THE INSPECTOR SHALL:**

A. inspect:

- 1. ventilation of attics and foundation areas.
- 2. mechanical ventilation systems.
- 3. the ventilation systems in areas where moisture is generated such as kitchens, bathrooms, laundry rooms.

#### **14.2 THE INSPECTOR IS NOT REQUIRED** TO:

#### **B. determine:**

1. indoor air quality.

2. system adequacy or distribution balance.

# GLOSSARY

#### Adjacent

Nearest in space or position; immediately adjoining without intervening space.

#### Alarm Systems

Warning devices, installed or free-standing, including but not limited to; carbon monoxide alarms, flue gas and other spillage alarms, security equipment, ejector pumps and smoke alarms

#### Architectural Service

Any practice involving the art and science of building design for construction of any structure or grouping of structures and the use of space within and surrounding the structures or the design for construction, including but not specifically limited to, schematic design, design development, preparation of construction contract documents, and administration of the construction contract, adequacy of design for the location and exposure to the elements.

#### **Automatic Safety Controls**

Devices designed and installed to protect systems and components from unsafe conditions.

#### Component

A part of a system.

#### Crawl Space

The area within the confines of the foundation and between the ground and the underside of the floor.

#### Decorative

Ornamental; not required for the operation of systems and components of a building.

#### Describe

To report a system or component by its type or other observed, significant characteristics to distinguish it from other systems or components.

#### Determine

To find out, or come to a conclusion by investigation.

#### Dismantle

To take apart or remove any component, device, or piece of equipment that would not be taken apart or removed by a homeowner in the course of normal and routine homeowner maintenance.

#### **Engineering Service**

Any professional service or creative work requiring engineering education, training, and experience and the application of special knowledge of the mathematical, physical and engineering sciences to such professional service or creative work as consultation, investigation, evaluation, planning, design and supervision of construction for the purpose of assuring compliance with the specifications and design, in conjunction with structures, buildings, machines, equipment, works or processes.

#### Functionality

The purpose that something is designed or expected to fulfill.

#### **Further Evaluation**

Examination and analysis by a qualified professional, tradesperson or service technician beyond that provided by the home inspection.

# Report No. 88685 www.carsondunlop.com

626 Adelaide St W. Toronto, ON June 10, 2024

OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE							

#### Home and Property Inspection

The process by which an *inspector* visually examines the *readily accessible systems* and *components* of a building in accordance with these National Standards of Practice.

#### **Household Appliances**

Kitchen, laundry, and similar appliances, whether *installed* or freestanding.

#### Inspect

APPENDIX

To examine *readily accessible systems* and *components* of a building in accordance with these National Standards of Practice, *where applicable* using *normal operating controls* and opening *readily openable access panels*.

#### Inspector

A person hired to examine any *system* or *component* of a building in accordance with these National Standards of Practice.

#### Installed

Set up or fixed in position for current use or service.

#### **Mechanical Ventilation Systems**

An active or powered air exhaust and/or intake system installed to remove moisture or contaminants from, or introduce fresh air into, the living space.

#### Normal Operating Controls

Devices such as thermostats, switches or valves intended to be operated by the homeowner.

#### Operate

To cause to function, turn on, to control the function of a machine, process, or system.

#### **Readily Accessible**

Available for visual inspection without requiring moving of personal property, *dismantling*, destructive measures, or any action which will likely involve risk to persons or property.

#### **Readily Openable Access Panel**

A panel provided for homeowner inspection and maintenance that is within normal reach, can be removed by one person, and is not sealed in place.

#### **Recreational Facilities**

*Spas*, saunas, steam baths, swimming pools, exercise, entertainment, athletic, playground or other similar equipment and associated accessories.

#### Report

To communicate in writing.

#### **Representative Number**

One *component* per room for multiple similar interior *components* such as windows and electric outlets; one *component* on each side of the building for multiple similar exterior *components*.

#### **Roof Drainage Systems**

Components used to carry water off a roof and away from a building.

#### Sample

A representative portion selected for inspection.

#### Service Life/Lives

The period during which something continues to function fully as intended.

#### Shut Down

A state in which a *system* or *component* cannot be operated by *normal operating controls.* 

#### Significant Deficiency

A clearly definable hazard or a clearly definable potential for failure or is unsafe or not functioning.

#### Solid Fuel Burning Appliances

A hearth and fire chamber or similar prepared place in which a fire may be built, and which is built in conjunction with a chimney; or a listed assembly of a fire chamber, its chimney and related factory-made parts designed for unit assembly without requiring field construction.

#### Spa

Residential recreational or therapeutic device.

#### Structural Component

A component that supports non-variable forces or weights (dead loads) and variable forces or weights (live loads).

#### System

A combination of interacting or interdependent components, assembled to carry out one or more functions.

#### **Technically Exhaustive**

An inspection is technically exhaustive when it is done by a specialist who may make extensive use of measurements, instruments, testing, calculations, and other means to develop scientific or engineering findings, conclusions, and recommendations.

#### **Technical Services**

Services that involve dismantling, the extensive use of advanced techniques, measurements, instruments, tools, testing, calculations, or other similar methods.

APPENDIXReport No. 88685626 Adelaide St W, Toronto, ONJune 10, 2024www.carsondunlop.com									
626 Adela	ide St VV, To	ronto, ON	June 10, 202	24					induniop.com
OVERVIEW	ROOFING	EXTERIOR	STRUCTURE	ELECTRICAL	HEATING	COOLING	INSULATION	PLUMBING	INTERIOR
OUR ADVICE	APPENDIX	REFERENCE							

#### Unsafe

A condition in a *readily accessible, installed system* or *component* which is judged to be a significant risk of personal injury during normal, day-to-day use. The risk may be due to damage, deterioration, missing or improper installation or a change in accepted residential construction Standards.

#### Vapour Retarder

Material used in the building envelope to retard the passage of water vapour.

#### Visually Accessible

Able to be viewed by reaching or entering.

Note - In these National Standards of Practice, redundancy in the description of the requirements, limitations and exclusions regarding the scope of the Home and Property Inspection is provided for clarity not emphasis.

(CAHPI acknowledges The American Society of Home Inspectors®, Inc. (ASH®) for the use of their Standards of Practice (version January 1, 2000)

(JANUARY 25, 2023 VER.G)

# Report No. 88685 REFERENCE LIBRARY www.carsondunlop.com 626 Adelaide St W, Toronto, ON June 10, 2024 ROOFING STRUCTURE COOLING INSULATION PLUMBING OUR ADVICE APPENDIX REFERENCE The links below connect you to a series of documents that will help you understand your home and how it works. These are in addition to links attached to specific items in the report. Click on any link to read about that system. 01. ROOFING, FLASHINGS AND CHIMNEYS $(\gg)$ 02. EXTERIOR (>>) $(\gg)$ 03. STRUCTURE 04. ELECTRICAL $(\mathcal{S})$ 05. HEATING (>>) $(\gg)$ 06. COOLING/HEAT PUMPS $(\gg)$ 07. INSULATION (>>)08. PLUMBING $(\gg)$ 09. INTERIOR $(\gg)$ **10. APPLIANCES 11. LIFE CYCLES AND COSTS** >>> **12. SUPPLEMENTARY** Asbestos Radon Urea Formaldehyde Foam Insulation (UFFI) Lead Carbon Monoxide Mold Household Pests **Termites and Carpenter Ants 13. HOME SET-UP AND MAINTENANCE 14. MORE ABOUT HOME INSPECTIONS**